



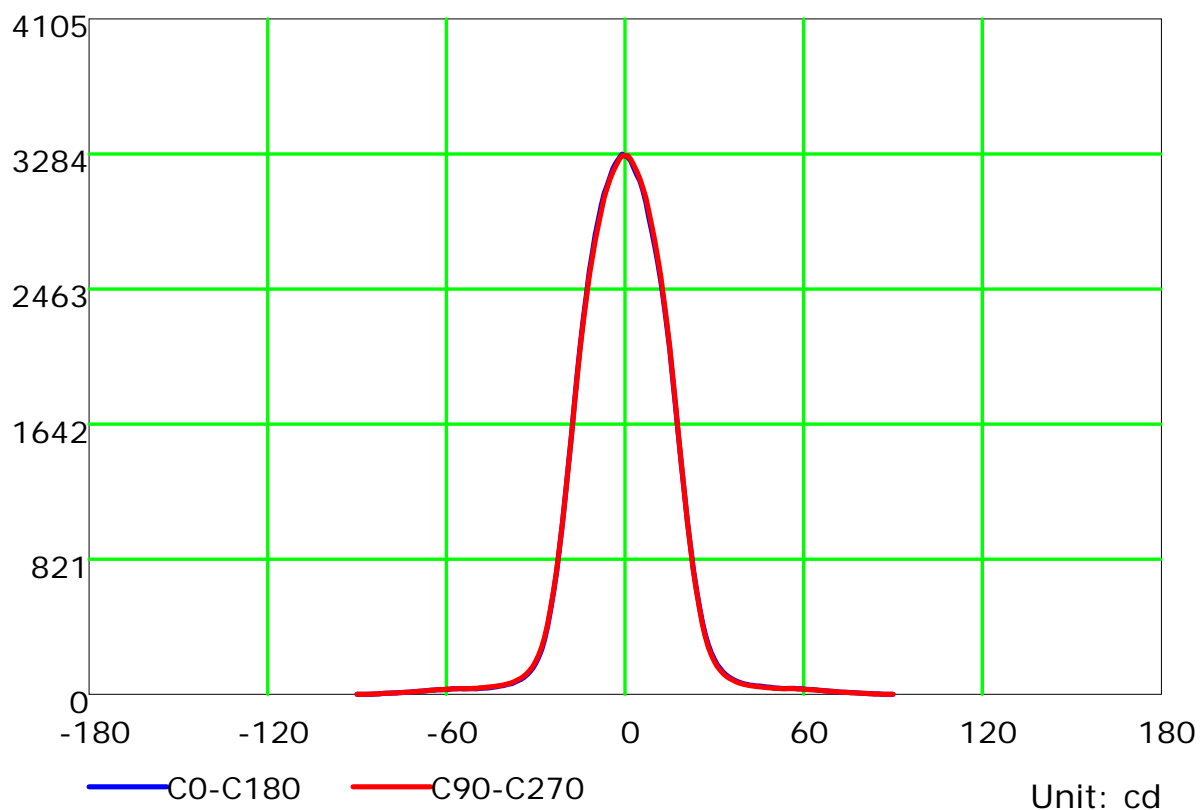

## Luminous Intensity Distribution Curve

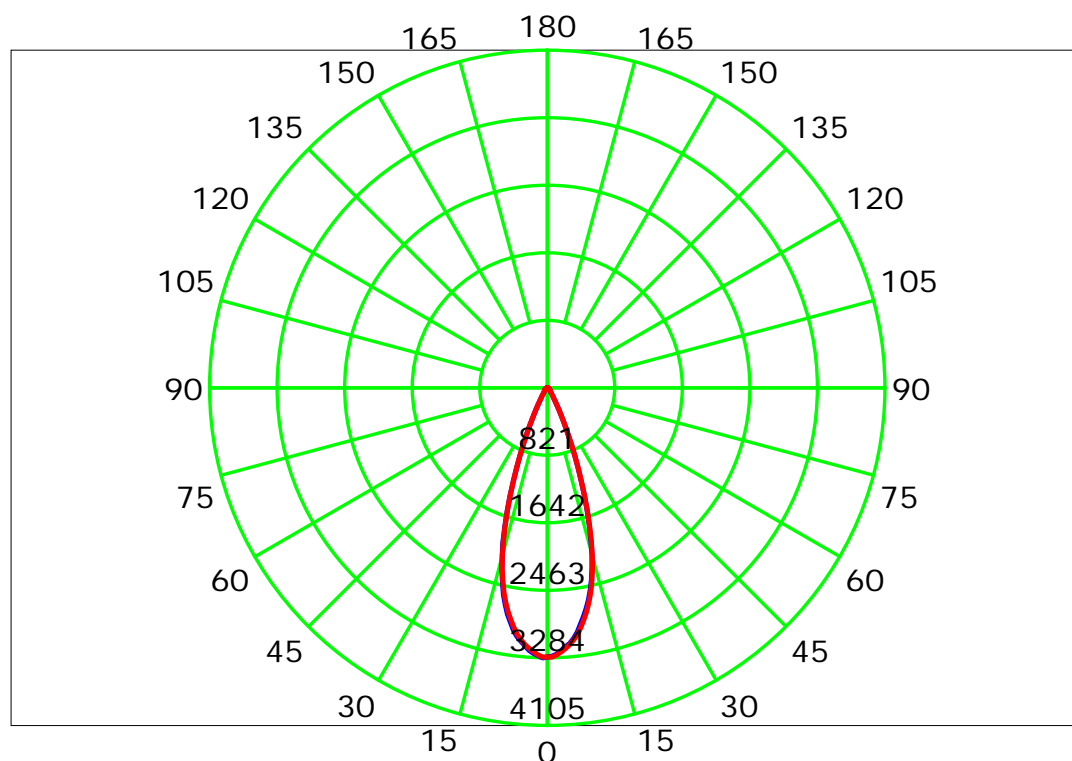

C Plane (°): 0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°): 0.0-90.0: 1.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

## Isocandela (rectangle)

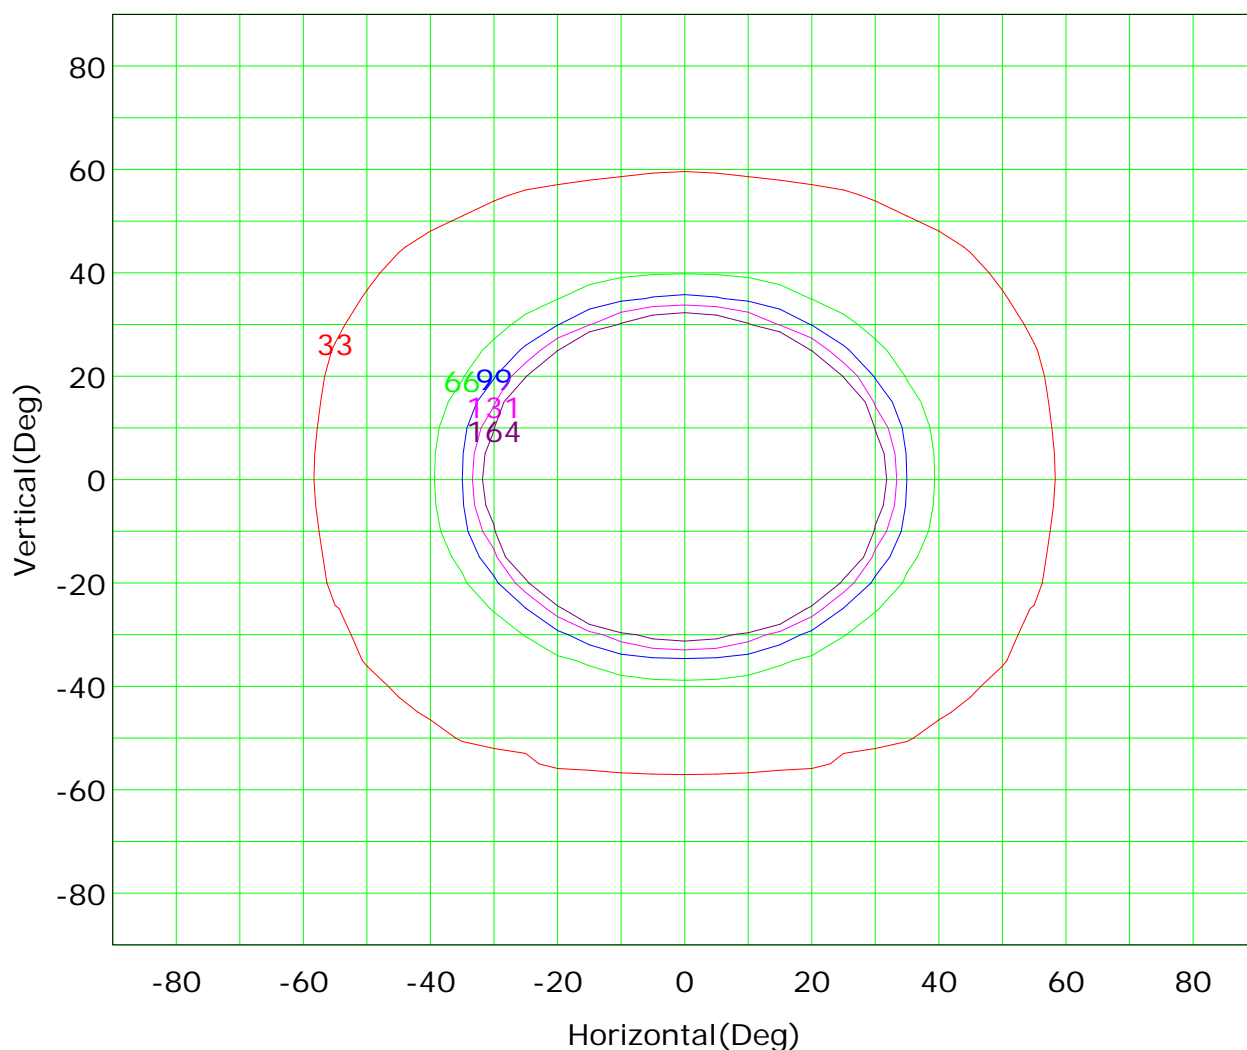

I<sub>max</sub> (100%): 3284 cd

( 1%): 33 cd  
( 3%): 99 cd  
( 5%): 164 cd

( 2%): 66 cd  
( 4%): 131 cd

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0: 1.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

## IsoLux Plot

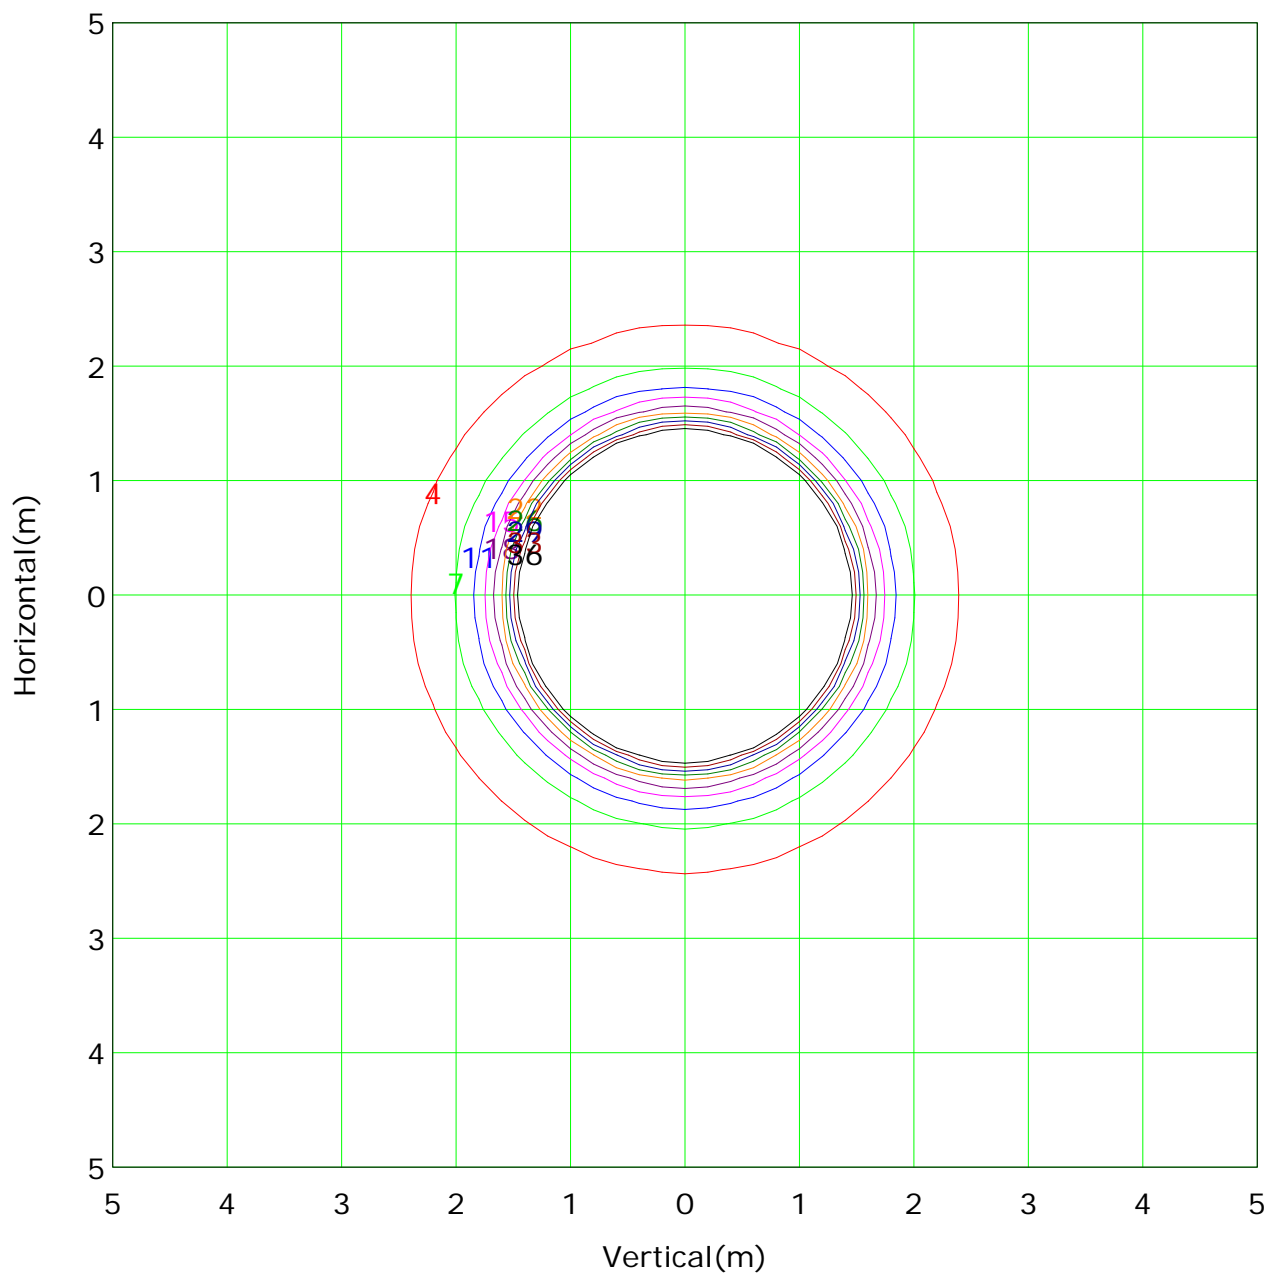

Mounting Height: 3m Max Lux(100%): 365 lx

( 1%): 4 lx	( 2%): 7 lx
( 3%): 11 lx	( 4%): 15 lx
( 5%): 18 lx	( 6%): 22 lx
( 7%): 26 lx	( 8%): 29 lx
( 9%): 33 lx	(10%): 36 lx

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0: 1.0


Test Device: CHL-6E

Distance: 3.000 m


Humidity:

Inspector:

## Illuminance at a Distance

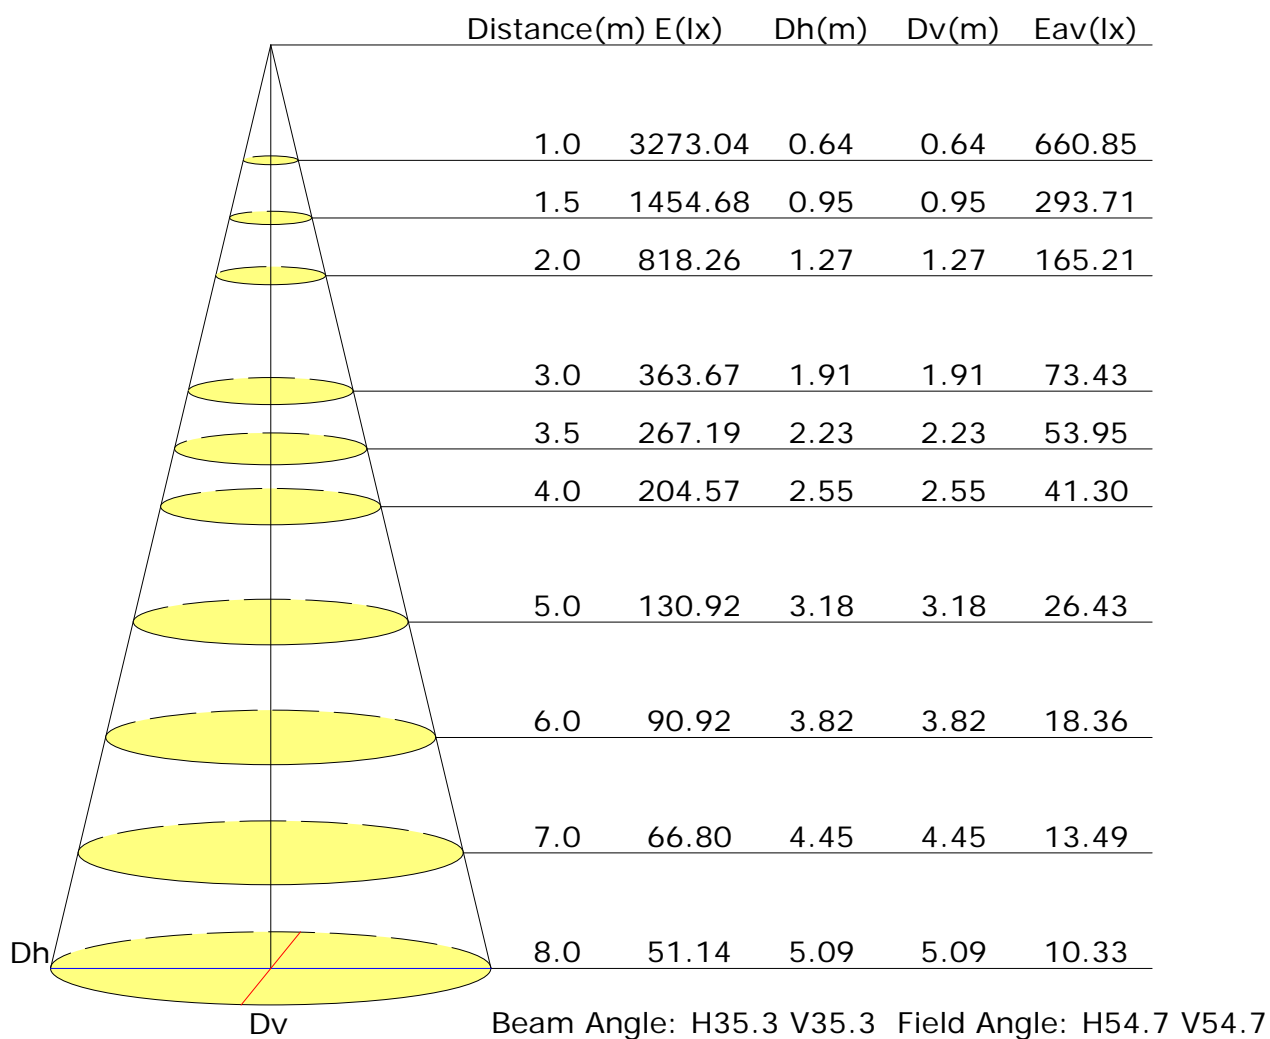

## Vertical IsoLux Plot

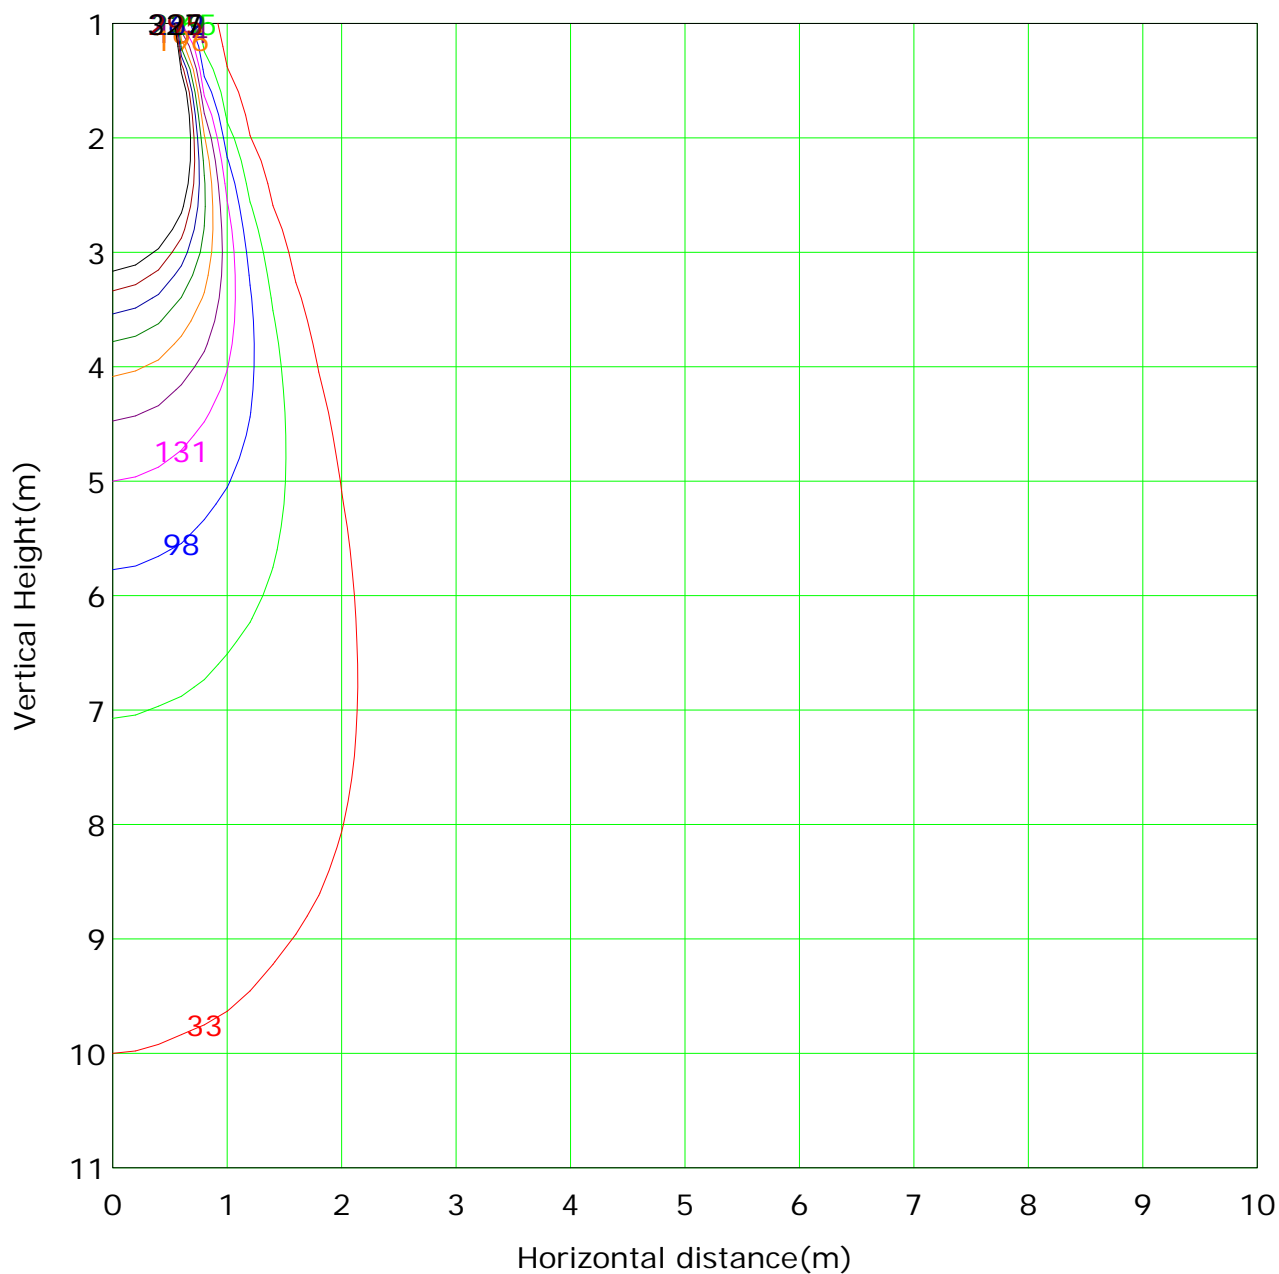

Lowest(m): 1m    Highest(m): 11    Max Lux: 3273	
( 1%): 33 lx	( 2%): 65 lx
( 3%): 98 lx	( 4%): 131 lx
( 5%): 164 lx	( 6%): 196 lx
( 7%): 229 lx	( 8%): 262 lx
( 9%): 295 lx	(10%): 327 lx

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0: 1.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

## The average illuminance effective figure

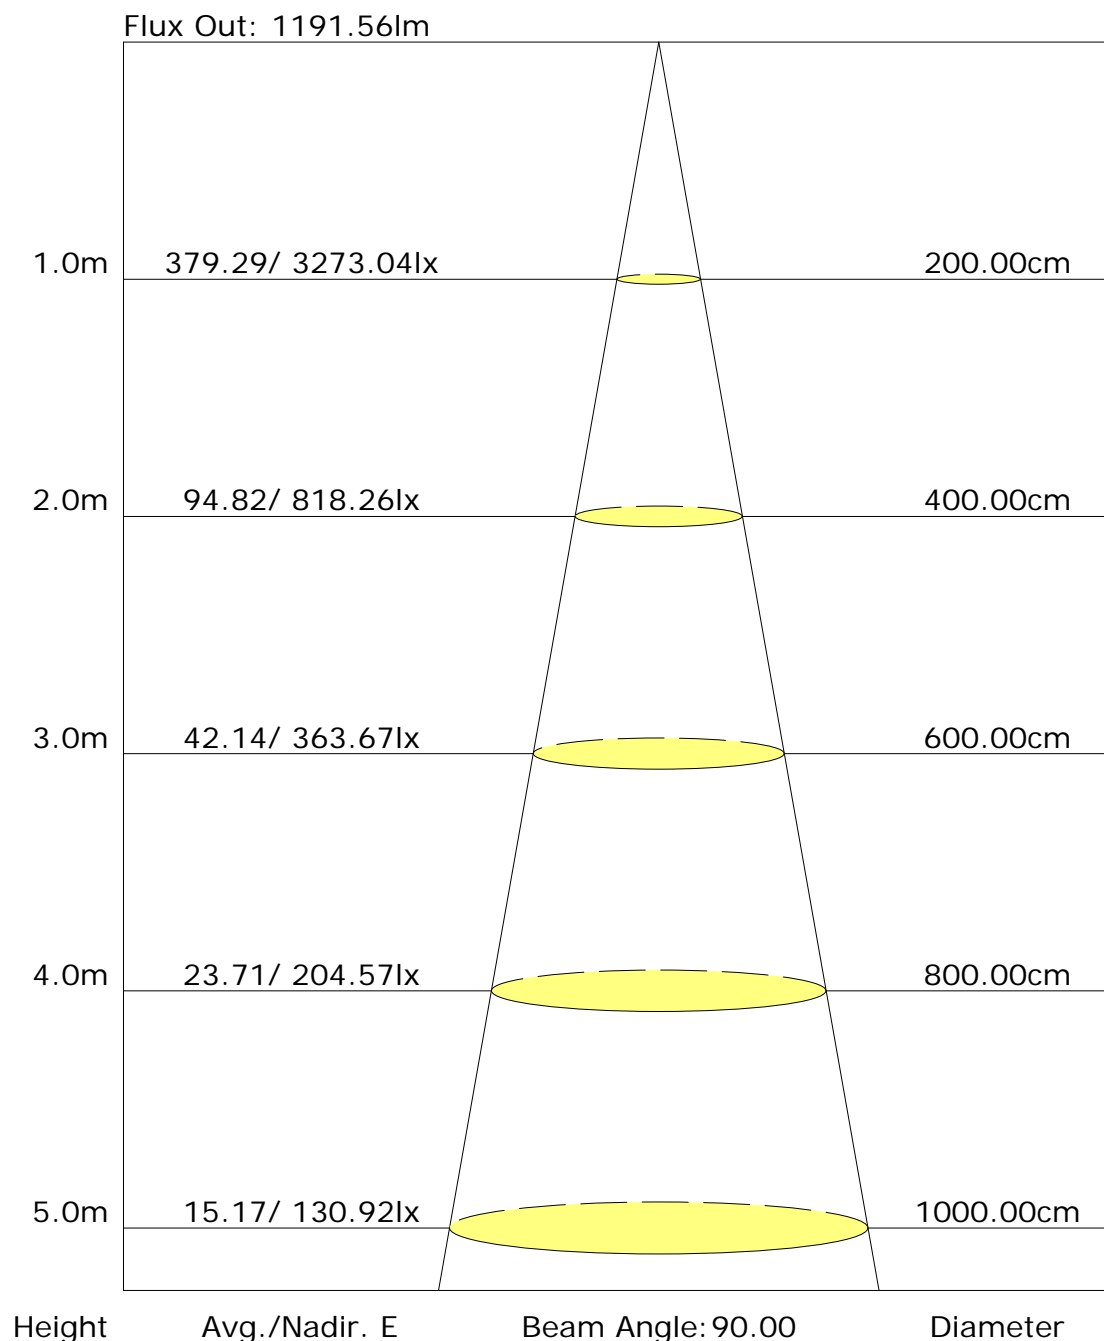

C Plane (°): 0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°): 0.0-90.0: 1.0

Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

## Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	3273.0	3273.0								
G1.0	3264.9	3283.9								
G2.0	3239.6	3258.6								
G3.0	3198.9	3233.3								
G4.0	3157.4	3198.9								
G5.0	3121.2	3146.5								
G6.0	3065.2	3095.0								
G7.0	2993.8	3045.3								
G8.0	2902.5	2973.0								
G9.0	2815.8	2882.7								
G10.0	2722.7	2794.1								
G11.0	2627.8	2682.9								
G12.0	2515.8	2571.8								
G13.0	2391.1	2429.9								
G14.0	2249.2	2287.1								
G15.0	2101.0	2127.2								
G16.0	1926.6	1962.7								
G17.0	1747.7	1771.2								
G18.0	1569.7	1580.5								
G19.0	1387.1	1399.8								
G20.0	1215.4	1214.5								
G21.0	1048.2	1047.3								
G22.0	900.0	890.1								
G23.0	758.2	747.3								
G24.0	639.8	622.6								
G25.0	533.2	513.3								
G26.0	440.1	416.6								
G27.0	362.4	335.3								
G28.0	302.7	273.8								
G29.0	252.1	226.8								
G30.0	213.3	188.9								
G31.0	180.7	159.0								
G32.0	157.2	136.4								
G33.0	134.6	118.4								
G34.0	118.4	103.0								
G35.0	104.8	91.3								
G36.0	94.0	83.1								

C Plane (°): 0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°): 0.0-90.0: 1.0

Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:



## Candlepower Table (Continue 1)

Unit: cd

GVC	C0.0	C180.0								
G37.0	84.0	74.1								
G38.0	76.8	66.0								
G39.0	69.6	62.3								
G40.0	64.2	57.8								
G41.0	60.5	53.3								
G42.0	56.0	50.6								
G43.0	55.1	47.0								
G44.0	51.5	44.3								
G45.0	50.6	41.6								
G46.0	48.8	39.8								
G47.0	46.1	38.0								
G48.0	44.3	37.0								
G49.0	43.4	36.2								
G50.0	39.8	33.4								
G51.0	38.9	34.3								
G52.0	37.0	34.3								
G53.0	35.2	34.3								
G54.0	35.2	33.4								
G55.0	36.2	34.3								
G56.0	36.2	34.3								
G57.0	36.2	33.4								
G58.0	33.4	34.3								
G59.0	34.3	30.7								
G60.0	32.5	30.7								
G61.0	30.7	28.9								
G62.0	29.8	28.0								
G63.0	28.9	28.9								
G64.0	28.0	25.3								
G65.0	24.4	25.3								
G66.0	23.5	23.5								
G67.0	21.7	21.7								
G68.0	20.8	19.9								
G69.0	19.0	19.0								
G70.0	18.1	17.2								
G71.0	16.3	16.3								
G72.0	14.5	14.5								
G73.0	13.6	13.6								

C Plane (°): 0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°): 0.0-90.0: 1.0

Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

