

Report No.: 51.05511 Recessed Downlight Test Time: 2022-05-25 19:30

Luminaire Property

Luminaire Category: Bridgelux V4HD 3000K CRI90

Voltage: 219.5 V

Current: 0.058 A

Power: 7.30 W

Power Factor: 0.561

Photometric Results

CIE Class: Direct

Measurement Flux: 555.6 lm

Downward Ratio: 100%

Total Rated Lamp Lumens: 555.6 lm

Efficiency: 100%

Upward Ratio: 0%

Horizontal Diffuse Angle(25%,50%,75%,100%): H43.2,H30.7,H21.1,H1

Vertical Diffuse Angle(25%,50%,75%,100%): V43.2,V30.7,V21.1,V1

Luminaire Efficacy Rating (LER): 76

Central Intensity: 1734.75 cd


Max. Intensity: 1739.34 cd

Pos of Max. Intensity: H180 V1

Picture Of Luminaire



Luminous Intensity Distribution Curve

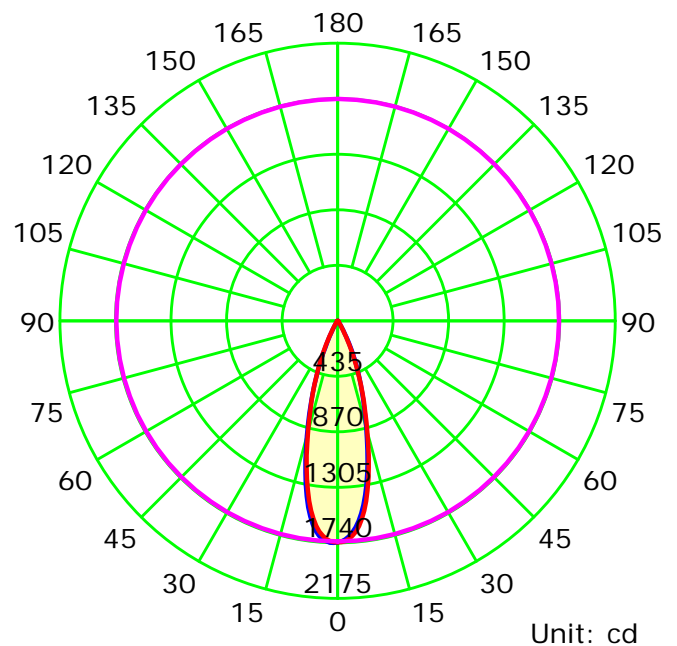

Average Diffuse Angle(50%): 30.7°

— C0-C180 — C90-C270 — G1

C Plane (°): 0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°): 0.0-90.0: 1.0



Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

Luminous Intensity Distribution Curve

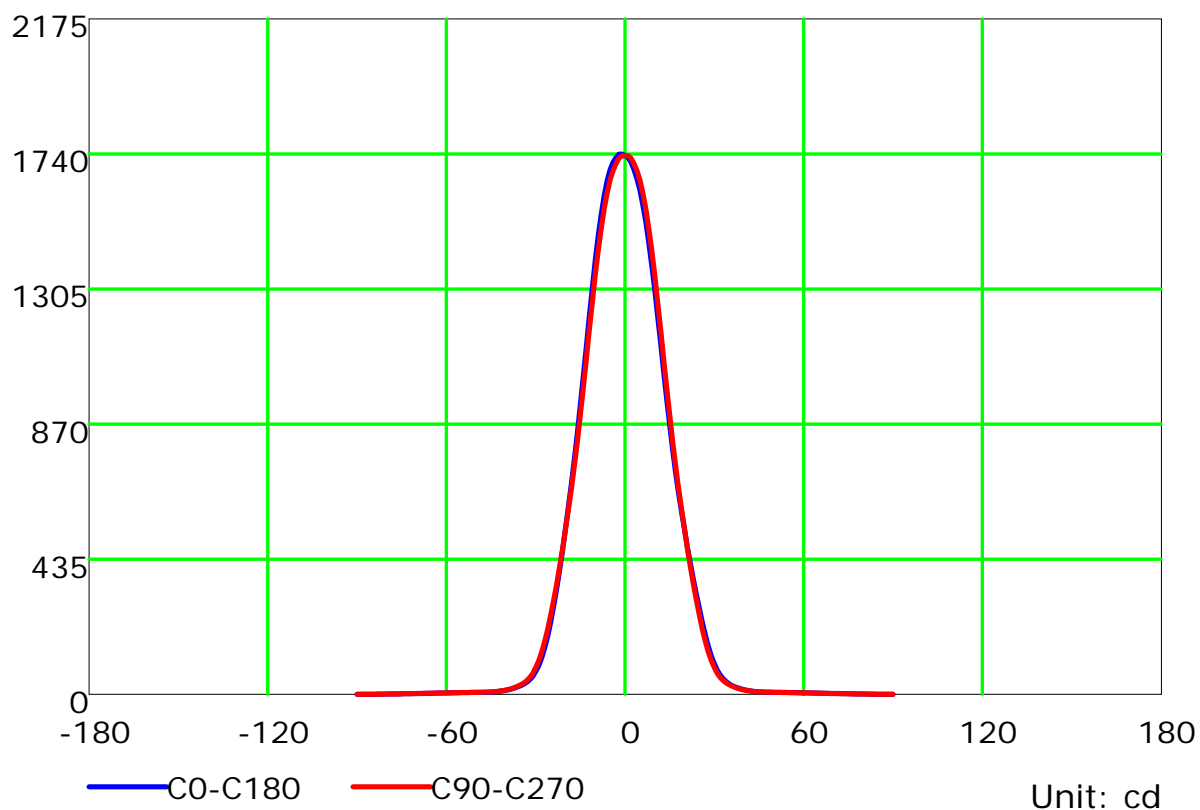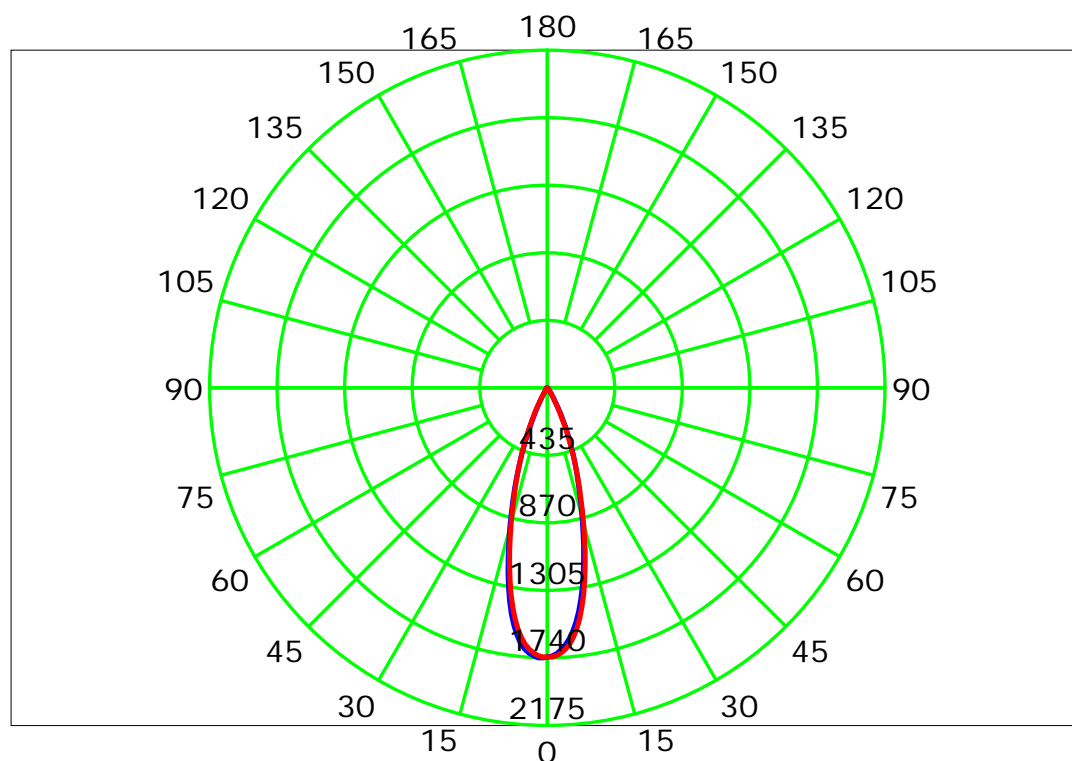

Unit: cd

C Plane (°): 0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°): 0.0-90.0: 1.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

Isocandela (rectangle)

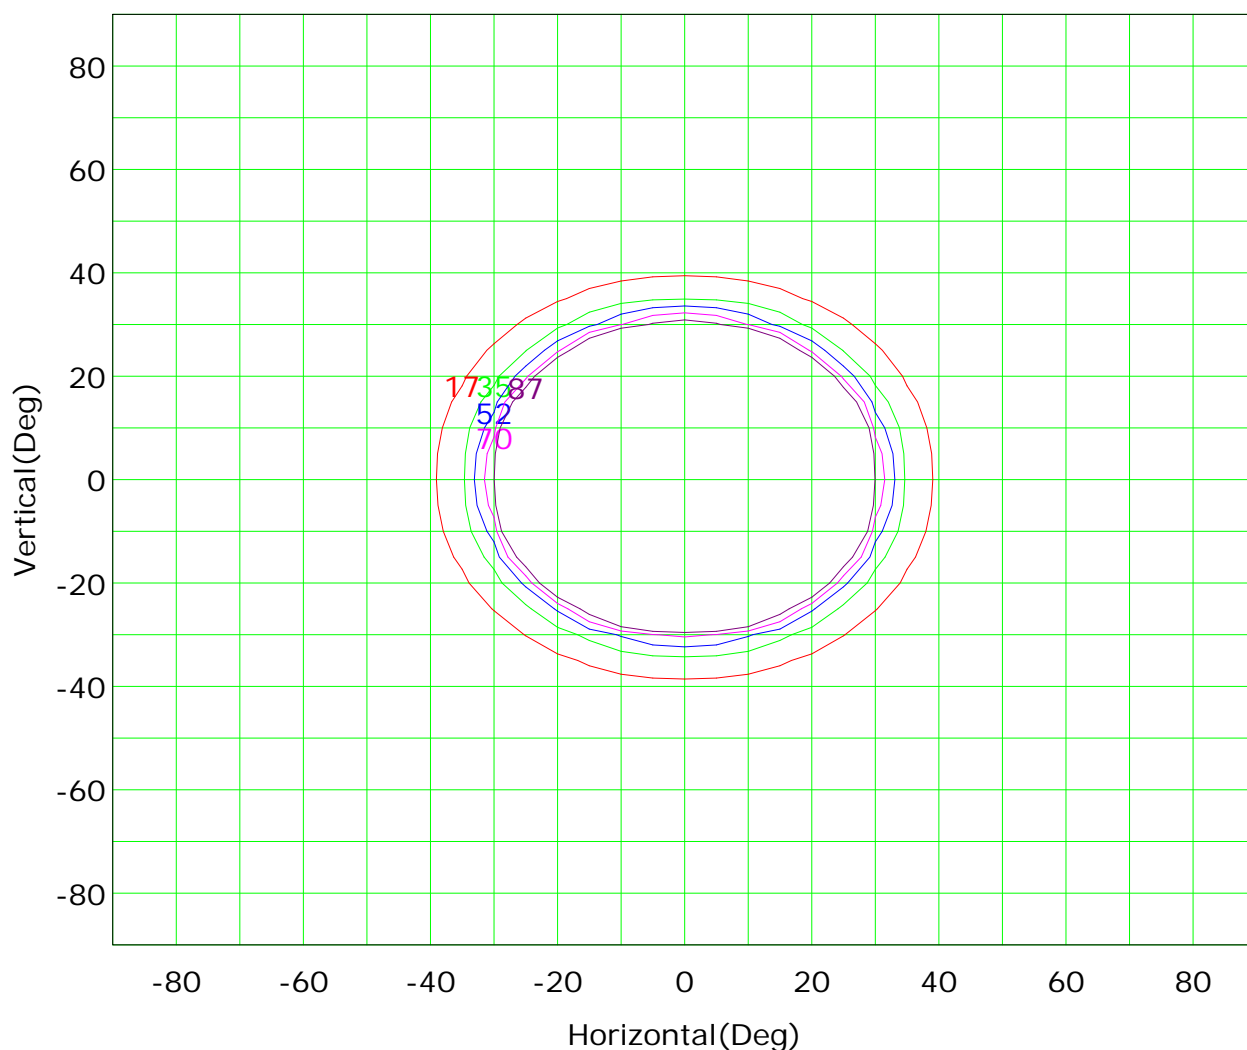

I_{max} (100%): 1739 cd

(1%):	17 cd	(2%):	35 cd
(3%):	52 cd	(4%):	70 cd
(5%):	87 cd		

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0: 1.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

IsoLux Plot

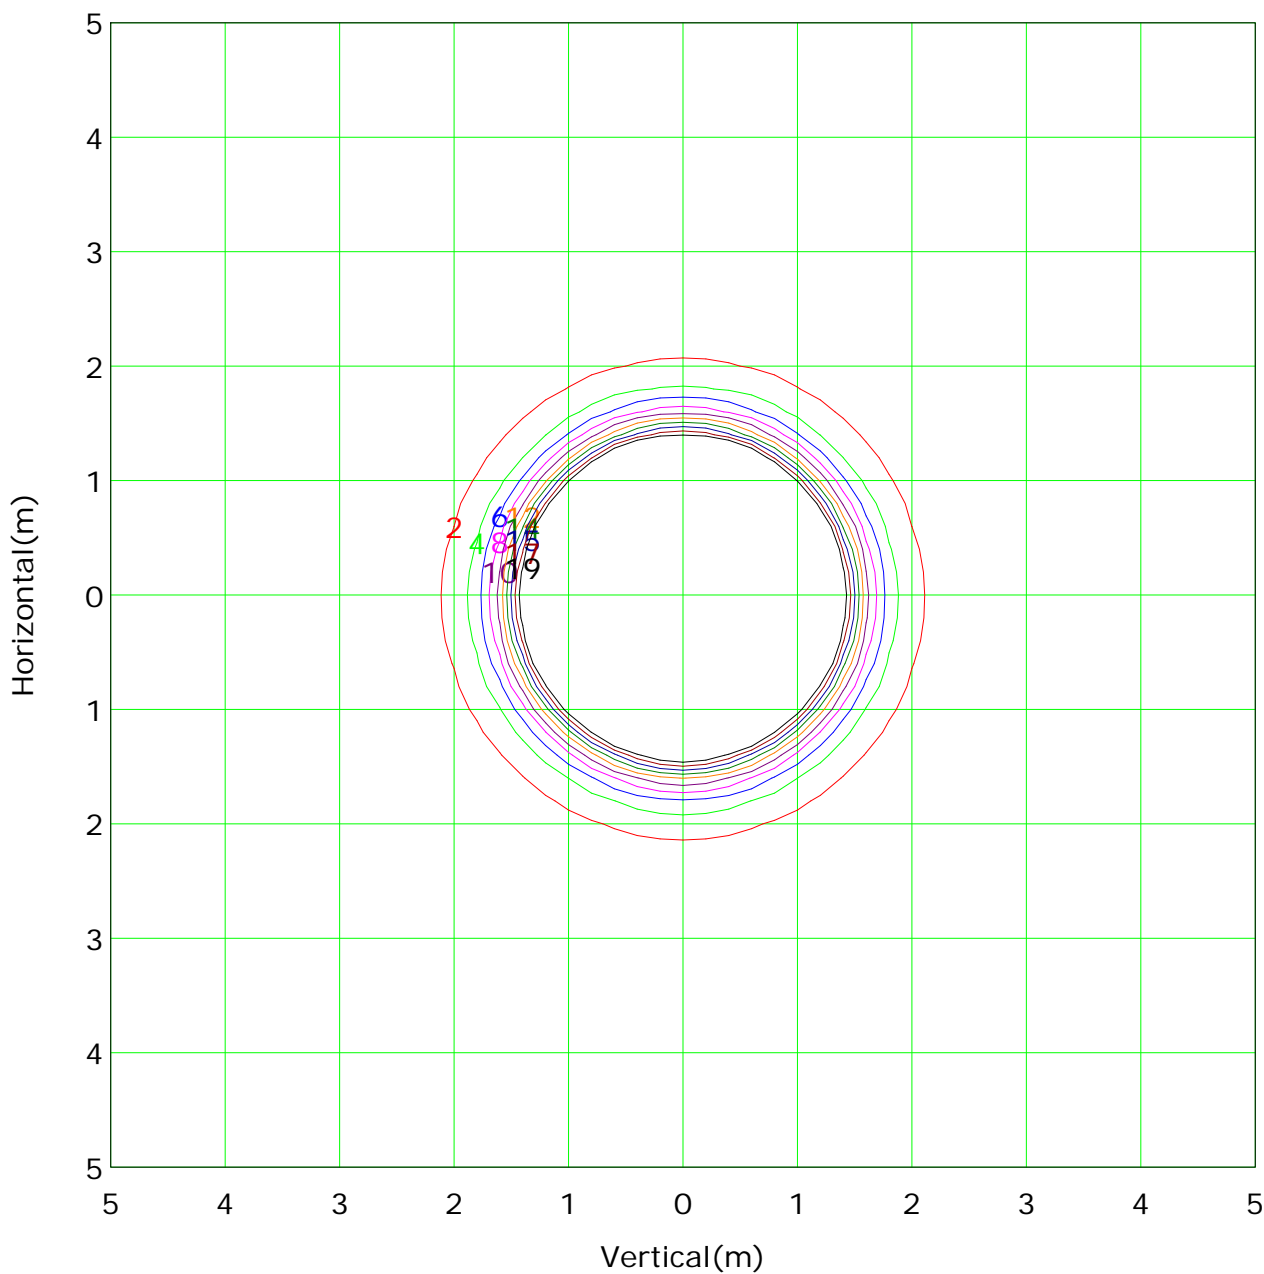

Mounting Height: 3m Max Lux(100%): 193 lx			
— (1%):	2 lx	— (2%):	4 lx
— (3%):	6 lx	— (4%):	8 lx
— (5%):	10 lx	— (6%):	12 lx
— (7%):	14 lx	— (8%):	15 lx
— (9%):	17 lx	— (10%):	19 lx

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0: 1.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

Illuminance at a Distance

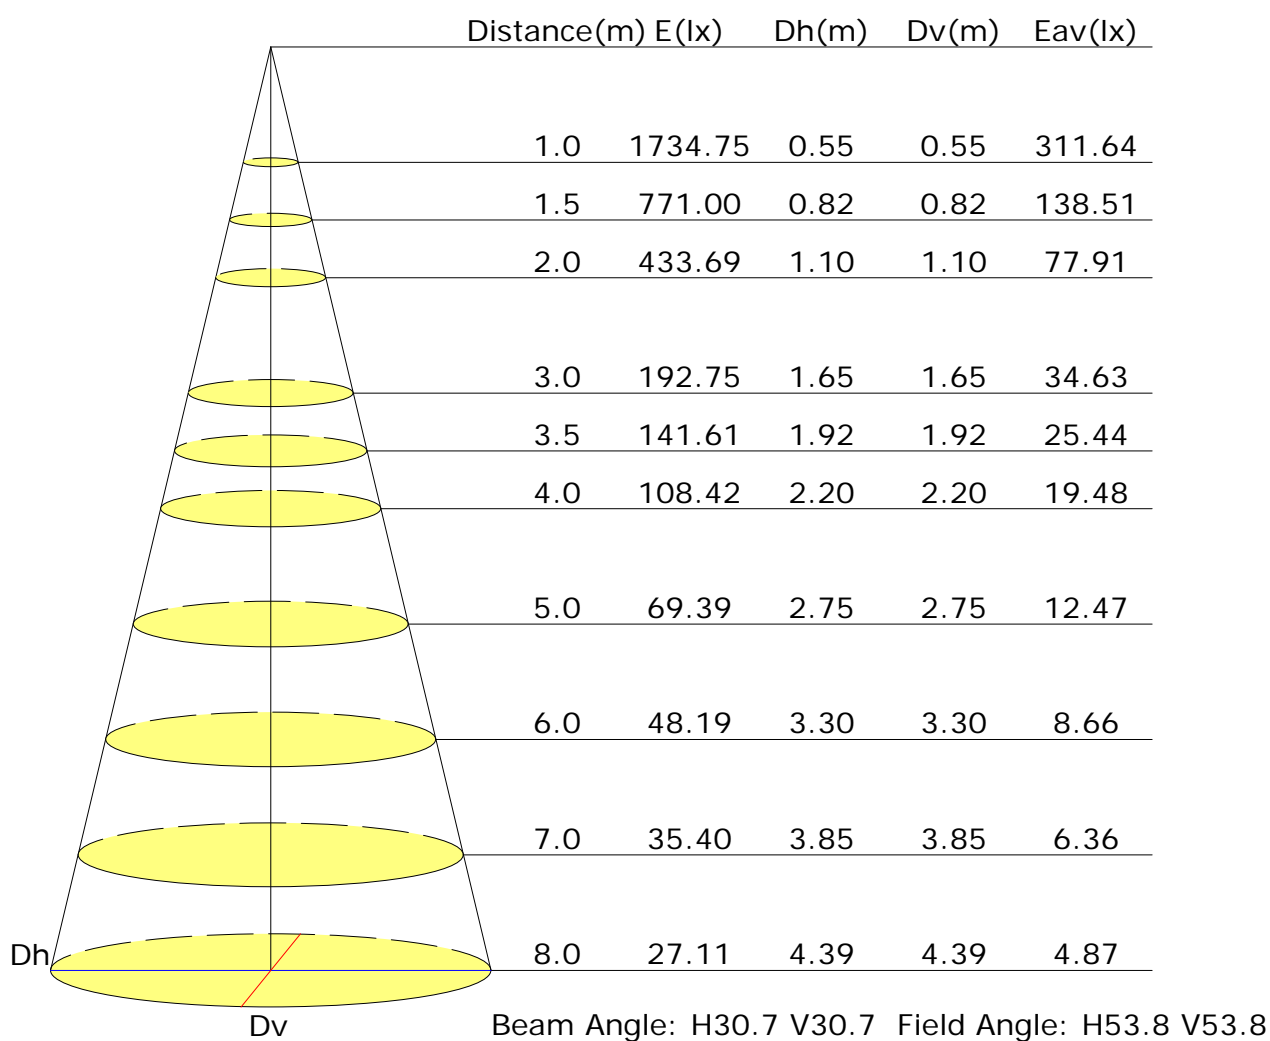

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0: 1.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

Vertical IsoLux Plot

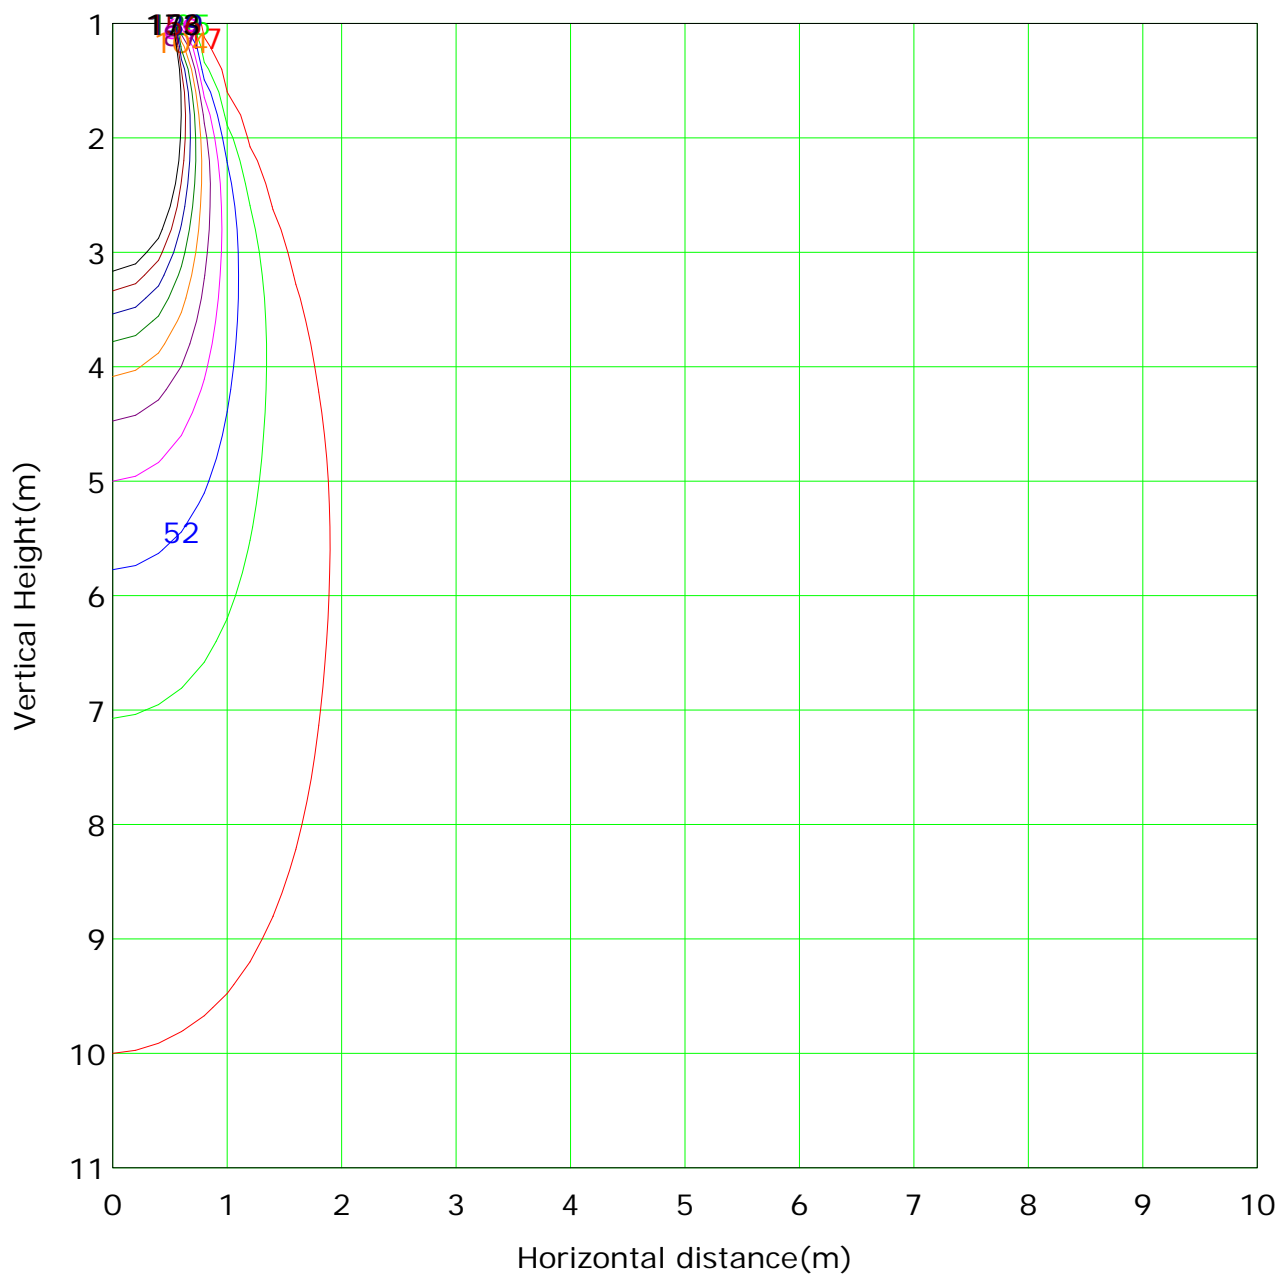

Lowest(m): 1m Highest(m): 11 Max Lux: 1735	
(1%): 17 lx	(2%): 35 lx
(3%): 52 lx	(4%): 69 lx
(5%): 87 lx	(6%): 104 lx
(7%): 121 lx	(8%): 139 lx
(9%): 156 lx	(10%): 173 lx

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0: 1.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

The average illuminance effective figure

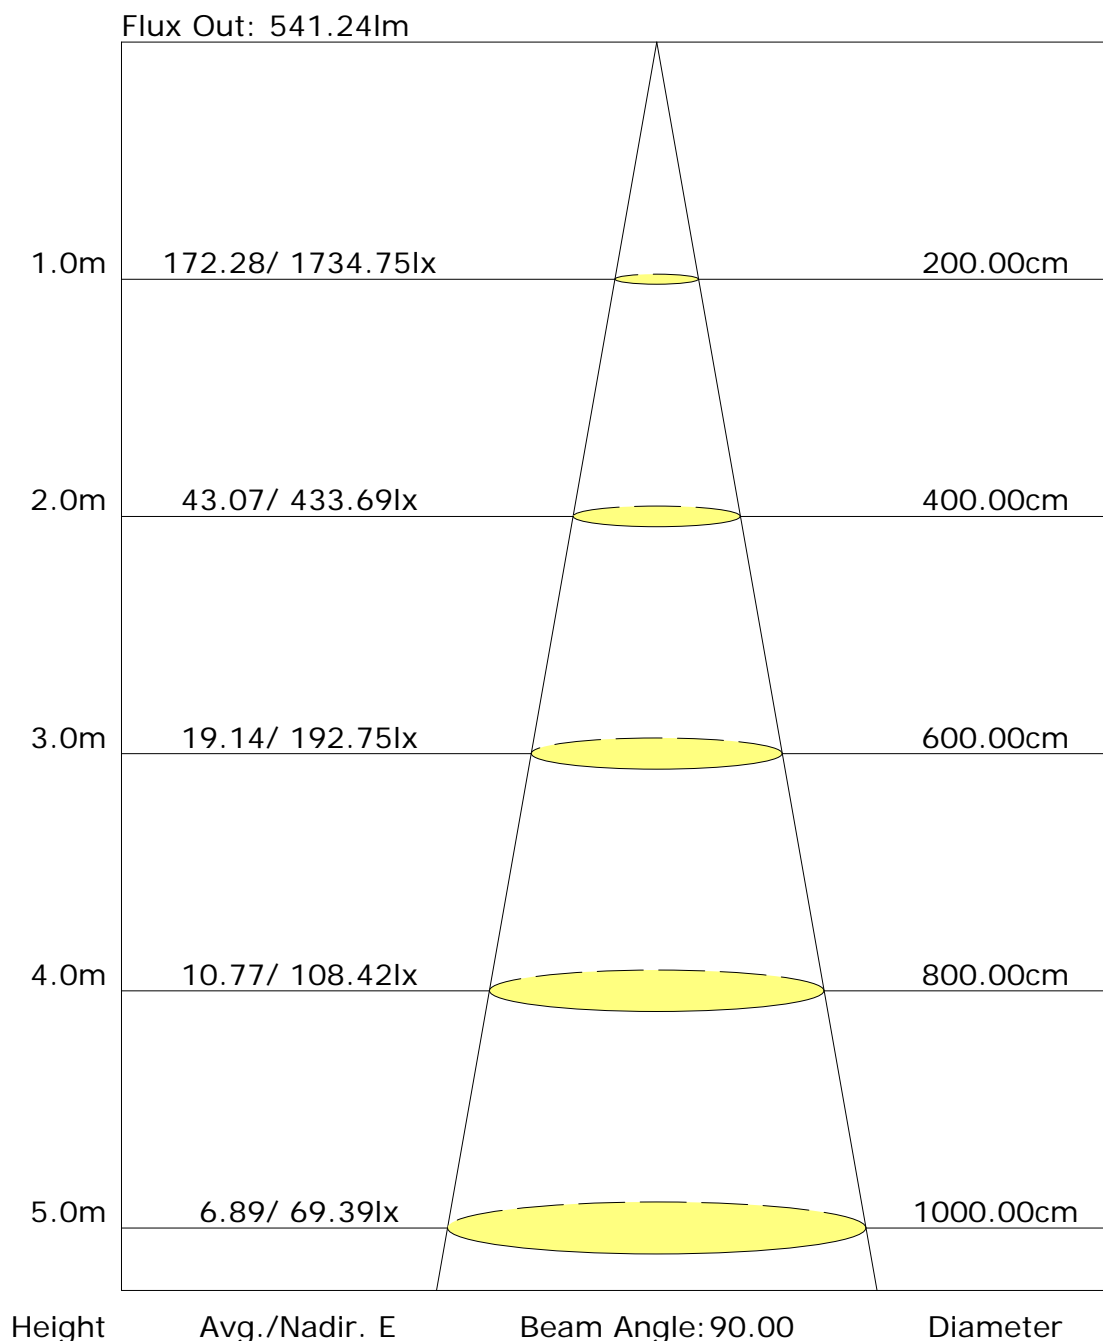

Candlepower Table

Unit: cd

GVC	C0.0	C180.0								
G0.0	1734.8	1734.8								
G1.0	1728.5	1739.3								
G2.0	1713.8	1739.1								
G3.0	1691.1	1728.5								
G4.0	1660.7	1713.2								
G5.0	1623.4	1688.9								
G6.0	1576.5	1654.8								
G7.0	1521.5	1605.2								
G8.0	1456.2	1547.0								
G9.0	1381.6	1477.5								
G10.0	1303.0	1396.6								
G11.0	1217.4	1307.7								
G12.0	1130.3	1216.7								
G13.0	1041.0	1122.1								
G14.0	952.8	1025.9								
G15.0	868.4	932.7								
G16.0	790.2	842.9								
G17.0	714.4	759.3								
G18.0	649.8	681.2								
G19.0	588.2	606.9								
G20.0	530.0	533.2								
G21.0	473.4	463.5								
G22.0	420.0	398.6								
G23.0	370.1	339.4								
G24.0	321.3	283.6								
G25.0	276.0	231.2								
G26.0	231.8	186.6								
G27.0	190.8	149.9								
G28.0	155.1	118.1								
G29.0	124.0	92.7								
G30.0	98.5	73.7								
G31.0	78.1	57.8								
G32.0	62.1	47.1								
G33.0	50.0	39.3								
G34.0	41.1	33.0								
G35.0	33.7	28.3								
G36.0	28.1	24.5								

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

Candlepower Table (Continue 1)

Unit: cd

GVC	C0.0	C180.0								
G37.0	24.0	21.1								
G38.0	20.8	18.0								
G39.0	17.8	15.1								
G40.0	15.3	13.1								
G41.0	13.1	11.5								
G42.0	11.5	10.3								
G43.0	10.3	9.1								
G44.0	9.1	8.1								
G45.0	8.0	7.6								
G46.0	7.7	7.2								
G47.0	7.4	6.9								
G48.0	7.1	6.6								
G49.0	6.9	6.5								
G50.0	6.7	6.4								
G51.0	6.5	6.2								
G52.0	6.5	6.0								
G53.0	6.3	5.8								
G54.0	6.2	5.8								
G55.0	6.0	5.8								
G56.0	5.8	5.4								
G57.0	5.8	5.3								
G58.0	5.6	5.1								
G59.0	5.3	4.9								
G60.0	5.1	4.7								
G61.0	4.9	4.5								
G62.0	4.7	4.3								
G63.0	4.4	4.1								
G64.0	4.3	3.8								
G65.0	4.0	3.6								
G66.0	3.8	3.6								
G67.0	3.6	3.2								
G68.0	3.4	3.1								
G69.0	3.1	2.9								
G70.0	2.9	2.7								
G71.0	2.8	2.5								
G72.0	2.7	2.3								
G73.0	2.3	2.2								

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

Unit: cd

[illegible]

Inspector: